

Backer Rod Mfg. Inc.


www.backerrod.com Customer Service (800) 595 2950



UL System No. HW-S-1014

November 19, 2008

Assembly Rating – 2 Hr Joint Width – 4 In. (102 mm) Maximum

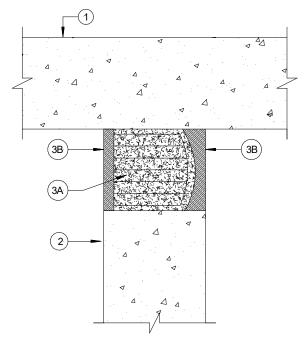

- 1. **Floor Assembly** Min 4-1/2 in. (114 mm) thick steel-reinforced lightweight or normal weight (100 150 pcf or 1600-2400 kg/m³) structural concrete.
- 2. **Wall Assembly** Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100 150 pcf or 1600-2400 kg/m³) structural concrete. Wall may also be constructed of any UL Classified Concrete Blocks*.
 - See Concrete Blocks (CATZ) category in the Fire Resistance Directory for names of manufacturers
- 3. **Joint System** Max separation between bottom of floor and top of wall is 4 in. (102 mm). The joint system shall consist of the following:
 - A. **Forming Material*** Min 11 in. (279 mm) width of forming material, folded in half and compressed min 40 percent into opening as a permanent form. Forming Material to be recessed from each surface of wall to accommodate the required thickness of fill material.

BACKER ROD MFG. INC. – ULTRA BLOCK®

B. **Fill, Void or Cavity Material*** - Min 1/2 in. (13 mm) thickness of fill material applied within the joint, flush with each surface of wall.

MOMENTIVE PERFORMANCE MATERIALS – PENSIL 300 SEALANT

SPECIFIED TECHNOLOGIES INC – PENSIL 300 SEALANT or SPECSEAL SERIES SIL300 SEALANT

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.